



## FEBRUARY METRO LIMITS

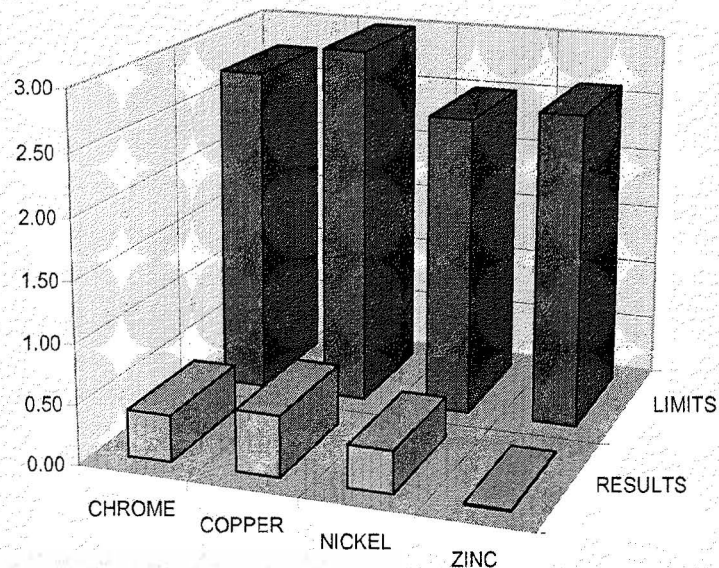

### ALASKAN COPPER WORKS

3200 FACILITY  
FEBRUARY 4, 2010  
COMPOSITE M05224

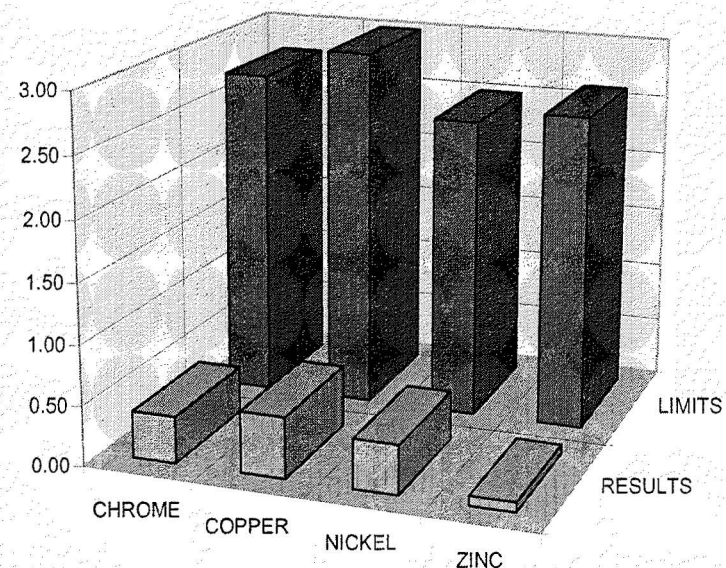

### ALASKAN COPPER WORKS

3200 FACILITY  
FEBRUARY 10, 2010  
COMPOSITE M12455


#### VISUAL REPRESENTATION OF THE LAB RESULTS

**NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES**

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.39	0.51	0.35	0.01
LIMITS	2.75	3.00	2.50	2.61


	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.39	0.51	0.41	0.08
LIMITS	2.75	3.00	2.50	2.61

**FEBRUARY  
METRO LIMITS**

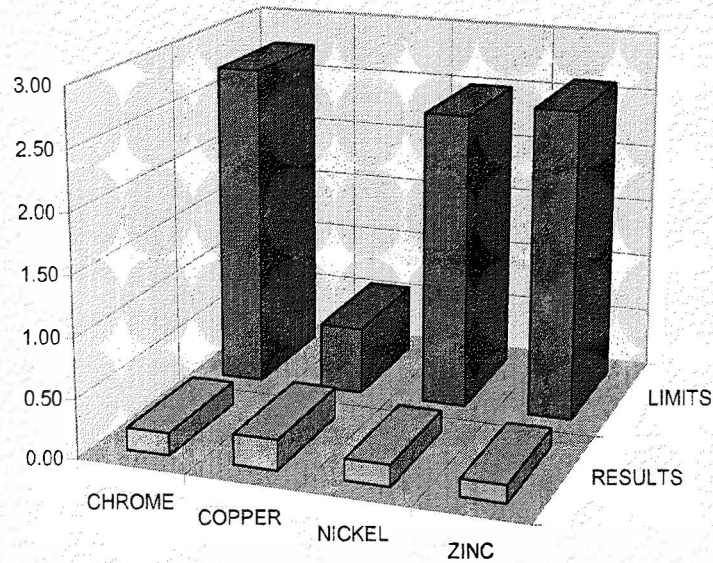

**ALASKAN COPPER WORKS**

3200 FACILITY  
FEBRUARY 18, 2010  
GRAB M05266

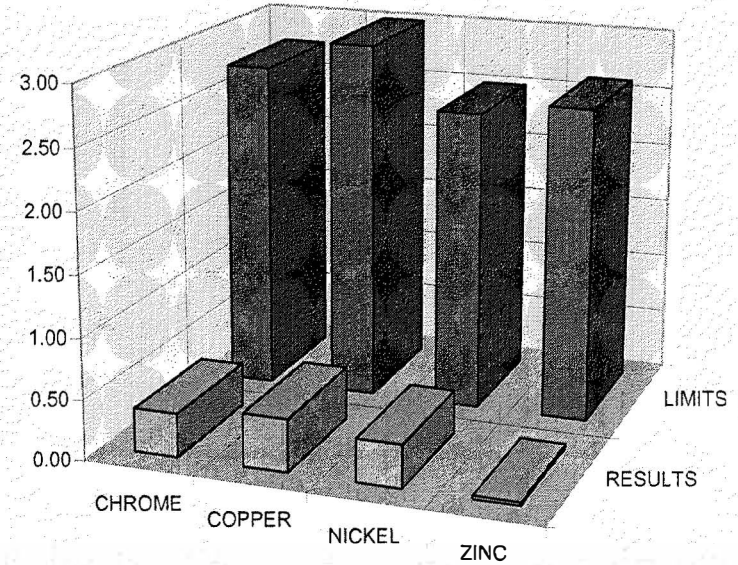

**ALASKAN COPPER WORKS**

3200 FACILITY  
FEBRUARY 25, 2010  
COMPOSITE M05294

**VISUAL REPRESENTATION OF THE LAB RESULTS**

**NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES**

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.19	0.26	0.18	0.15
LIMITS	2.75	0.57	2.50	2.61

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.36	0.44	0.36	0.03
LIMITS	2.75	3.00	2.50	2.61